


| 仪器型号 |     | NTS-362R s                            |  | NTS-362R |
|------|-----|---------------------------------------|--|----------|
| *    | ( ) |                                       |  |          |
|      |     | k                                     |  | k        |
|      |     | - + ° ' v D k k                       |  |          |
|      |     |                                       |  |          |
| ( )  |     |                                       |  |          |
| %    | ~   | k                                     |  | k        |
|      |     | k - + ° ' v D k k   k - + ° ' v D k k |  |          |
|      |     | .                                     |  |          |
|      |     |                                       |  |          |
|      |     | k k                                   |  |          |
|      |     | - / - / -                             |  |          |
|      |     | -                                     |  |          |
|      |     |                                       |  |          |
|      |     | k k                                   |  |          |
|      |     | k k                                   |  |          |
|      |     | X                                     |  |          |
|      |     | ~                                     |  |          |
|      |     | -                                     |  |          |
|      |     | . k                                   |  |          |
|      |     |                                       |  |          |
|      |     | ( - / - . )                           |  |          |
|      |     |                                       |  |          |
|      |     | _ / k k                               |  |          |
|      |     | _ / k k                               |  |          |
|      |     |                                       |  |          |
|      |     | - . k k . k                           |  |          |
|      |     |                                       |  |          |
|      |     | +                                     |  |          |
|      |     | . k k                                 |  |          |
|      |     |                                       |  |          |
|      |     | /U                                    |  |          |
|      |     |                                       |  |          |
|      |     | / kAH                                 |  |          |
|      |     | . V                                   |  |          |
|      |     |                                       |  |          |
|      |     | k kX k kX k k                         |  |          |
|      |     | . Ke                                  |  |          |

\* ~ ~ ~ i k,D p

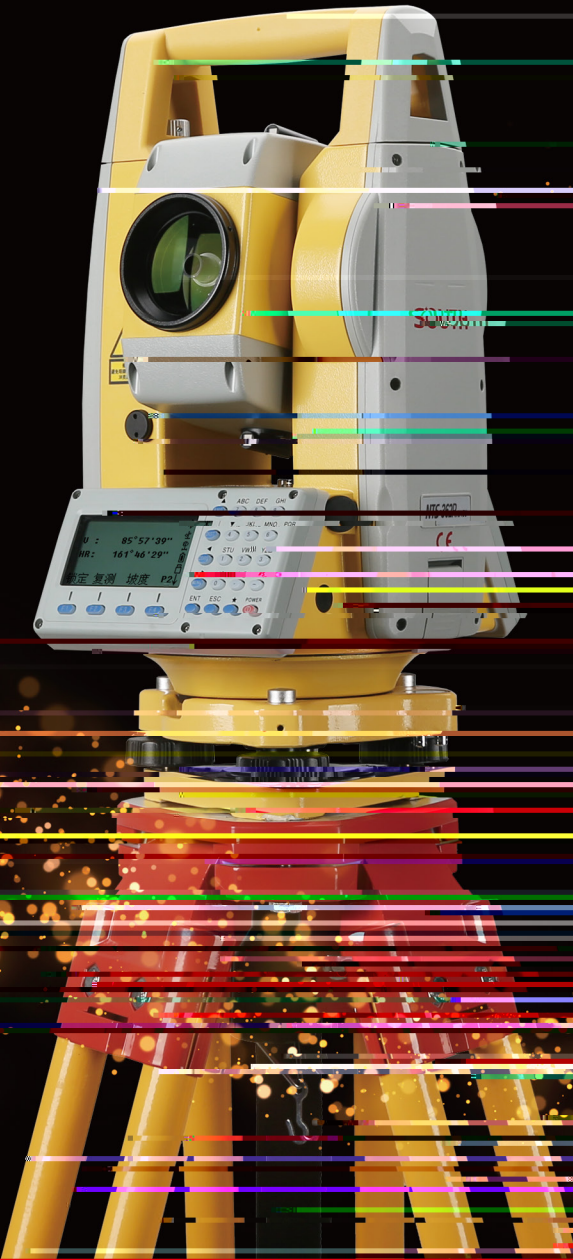

s

⊙

k

⌘

